

# Analogue Meters FQ0x07 series

₹ FQ - Moving-iron panel instruments with exchangeable scales FQ0107, FQ0207, FQ0307, FQ0407 & FQ0507<sup>1)</sup>

- For measurement of AC currents and voltages
- Good read-out survey on larger distance
- o Moving-coil Panel instruments with exchangeable scales
- Resistance to mechanical vibrations
- Protective cover for terminals (optional)





# PROPERTIES

- For measurement of AC currents and voltages
- Good read-out survey on larger distance
- o Moving-coil Panel instruments with exchangeable scales
- o Resistance to mechanical vibrations
- o Protective cover for terminals (optional)

## **APPLICATION**

Moving-iron instruments are intended for installation in supervision panels of power distribution stations and transformer stations or wherever a.c. voltages and currents are to be measured in heavy-current installation. The incorporated moving-iron mechanism measures r.m.s. values of a.c. currents in frequency range 15 to 100 Hz, independent of curve shape, on requests and voltages.

# **CONSTRUCTION**

The mechanism is a sprung pivot bearing type with silicon oil damping.

Non-linear graduations at the beginning of the scale allows reading from approximately 15 % of measuring range onwards.

Ammeters also have indicator range for double value of rated current (overcurrent scale) whereby the overload range is non-lineary graduated. Both versions are available. For milliammeters the measuring and indicator ranges coincide.

The special case design allows quick dial exchange for either new or old model. This is especially suitable for instruments which are connected to current or voltage transformers (x A/1 A, x A/5 A, x V/100 V, x V/110 V).

# THE EXCHANGEABLE SCALE HAS A NUMBER OF ADVANTAGES:

- quick and simple adaptation of the instrument to variable user technical requirements
- shorter delivery time
- allows flexible planning

#### **SHIP'S VERSION**

Special versions are available for panel mounting into ships. These are mechanically resistant and additionally sealed instruments which comply with the requirements of Lloyd registers. The instrument case is marked by an anchor: t and a capital letter L at the end of the type designation. (e.g. FQ0207L)

- <sup>1)</sup> For assembly FQ0507 rail mounting according to DIN 46277 and EN 50022. Bezel measures are 45x45 mm. Technical data are the same as for FQ0407.
- <sup>2)</sup> At reference conditions for size 96x96 (FQx207) and 144x144 mm (FQx107) only.

## **TECHNICAL DATA**

#### ACCURACY:

| Accuracy class        | 1.5               |
|-----------------------|-------------------|
| Accuracy – on request | (standard)        |
|                       | 1.0 <sup>2)</sup> |
|                       | (optional)        |

### DESIGN:

| Material of housing:                                   |                                  | PC                |  |  |  |  |  |  |  |
|--|----------------------------------|-------------------|--|--|--|--|--|--|--|
| uninflammable, according to <b>UL 94</b>               |                                  |                   |  |  |  |  |  |  |  |
| Enclosure protection: Case IP 52, terminal contacts IP |                                  |                   |  |  |  |  |  |  |  |
|  | (IP 20 for connection terminals) |                   |  |  |  |  |  |  |  |
|  | according to EN 60529            |                   |  |  |  |  |  |  |  |
| Operating position                                     |                                  | Vertical          |  |  |  |  |  |  |  |
| Installation category (V                               | /rms):                           | CAT III 600 V     |  |  |  |  |  |  |  |
|  | (FQ0407 CAT <b>II</b>            | 600 V/ III 300 V) |  |  |  |  |  |  |  |
| Consumption:   | Ammeters                         | 0.3 1.2 VA        |  |  |  |  |  |  |  |
|  | Voltmeters                       | 1.5 4 VA          |  |  |  |  |  |  |  |

#### AMBIENT CONDITIONS

Climatic conditions:

JVF (DIN 40 040)

|                       |          | Standards EN 60051-1<br>EN 60051-2<br>EN 60051-9 |
|-----------------------|----------|--|
| Temperature:          |          |  |
| Reference range of or | peration | +18 +28°C  |
| Nominal range of ope  | ration   | -25 +55°C  |
| Storing               |          | -40 +70°C  |
| Humidity              | up to 80 | % (without condensing)                           |




#### **MEASURING RANGE:**

| AMMETERS <sup>2)</sup> :                      |             |             |  |
|---|-------------|-------------|--|
| Measuring range (mA)                          |             |             | 100 150 250 400 600                        |
| Measuring range (A)                           |             |             | 1 1.5 2.5 4 6 10 15 25 40 <sup>1)</sup> 60 |
| Measuring range (A)                           | x A / 1 A   | x A / 5 A   | for connection to instrument transformer   |
| VOLTMETERS:                                   |             |             |  |
| Measuring range (V)                           |             | 6 10        | 15 25 40 60 100 150 250 400 600            |
| Measuring range (V)                           |             |             | 400 500 600                                |
|   | x V / 100 A | x V / 110 V | for connection to instrument transformer   |
| <sup>1)</sup> Not available for size 48x48 mm |             |             |  |


<sup>2)</sup> Available also with 100% overload

Instruments for connection to instrument transformers have the following measuring ranges:

1 - 1.2 - 1.5 - 2 - 2.5 - 3 - 4 - 5 - 6 - 7.5 (8) and decade multiples.

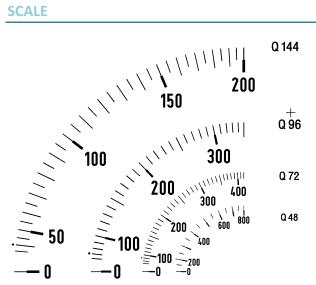

Picture 1: Drawing of scale: FQ0107, FQ0207, FQ0307, FQ0407 & FQ0507 (voltmeters, ammeters)

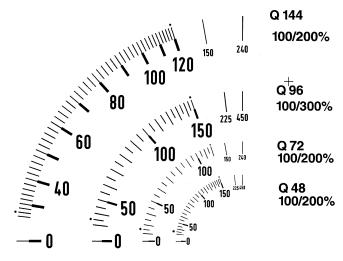


Picture 2: Drawing of scale: Version with overload (ammeters)

#### **EXCHANGING OF SCALES**


Press the cover, on top of the instrument, in the direction of the arrow and extract the scale with a suitable tool. After exchanging the scale, carefully close the opening with the cover.

The instrument must be disconnected during the dial exchange procedure.

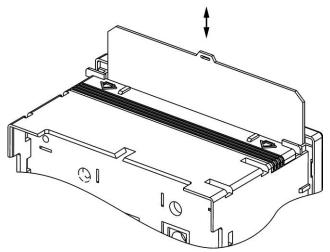


Picture 3: Exchanging of scales

# **DIMENSIONAL DRAWING**

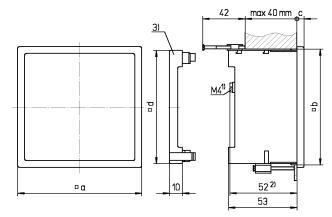

#### Picture 4: Dimensional drawing FQ0107, FQ0207, FQ0307 and FQ0407 (all dimensions are in mm)

- 1) Range 30 to 40 A M6
- 2) Range 30 to 40 A 59 mm
- 3) Protective cover (on special request)



Picture 5: Dimensional drawing FQ0507 (all dimensions are in mm)

#### **DATA FOR ORDERING**

- Instrument type,
- Measuring range and scale,
- Transmission ratio of instrument transformer.


| Туре                   |    | FQ0107              | FQ0207             | FQ0307             | FQ0407             | FQ0507 |  |
|------------------------|----|---------------------|--------------------|--------------------|--------------------|--------|--|
| Bezel<br>(mm)          | □a | 144                 | 96                 | 72                 | 48                 | 45     |  |
| Panel cut-<br>out (mm) | □b | 138 <sup>+1.0</sup> | 92 <sup>+0.8</sup> | 68 <sup>+0.8</sup> | 45 <sup>+0.6</sup> |        |  |
| Bezel height<br>(mm)   | с  | 8.0                 | 5.5                | 5.5                | 5.0                |        |  |
| Protect<br>cover (mm)  | □d | 90                  | 90                 | 66.5               | 42.5               |        |  |
| Scales<br>length (mm)  |    | 135                 | 92                 | 62                 | 41                 | 41     |  |
| Weight<br>approx. (kg) |    | 0.4                 | 0.2                | 0.18               | 0.14               | 0.14   |  |

Table 1: Dimensions and weight

#### **CONNECTION**

Instruments with measuring ranges above 15 A must be connected as per lower drawing.

For different wire connections an inaccurate reading may be obtained.



Picture 6: Instruments with measuring ranges above 15 A

#### **ORDERING EXAMPLE FOR STANDARD VERSION:**

- Voltmeter FQ0207, 0 600 V
- Voltmeter FQ0207, 110/0.1 kV 150 kV
- Ammeter FQO207, 250/5 A 250 A
- Ammeter FQ0207, 1500/5 A 3000 A (overcurrent scale)

When ordering scales, state same data as when ordering the instrument.

- Scale for ammeter FQ0207; 250/5 A 250 A
- Scale for ammeter FQ0207, 1500/5 A 3000 A (overcurrent scale)

#### **ORDERING CODE**

\*Standard version.

| Туре   | Class                                   | Zero Position | Unit | Rating  | Frequency<br>Range              | Finish       | Window   | Dial   | Illuminated<br>Scale   | Index Type  | Zero Adjuster<br>Colour   | Frame<br>Colour  | Protection<br>Cover | Mounting<br>Position |                                       |           |  |
|--|---|---------------|------|---|---------------------------------|--------------|--|--|--|---|---|--|---------------------|----------------------|---------------------------------------|-----------|--|
| FQ0x07<br> <br> | H<br>S<br>Front f<br>Front f<br>Front f | X             | <br> | 1 1.2<br>6 8 2<br>ero *<br>44x144<br>6x96<br>2x72<br>8x48 | 120 15<br>2 1.5 2<br>10 12<br>" | 50 20<br>2 3 | Inc. M<br>IP54<br>Ship V<br>Ship V<br>Ship V<br>00 Hz<br>00 250<br>4 5 ( | Clear<br>Anti-<br>Polyc<br>Polyc<br>ardna<br>IP54<br>Tropic<br>lech. F<br>'er. + I<br>'er. + F<br>'er. + F<br>0 300<br>5 7.5<br>40 50<br>600 | X<br> <br> <br> <br> <br> <br>N<br>A<br>B<br>C<br>Bianco<br>Standa<br>Black, V<br>No Dia<br>Black, V<br>Glass *<br>Glass +<br>Glare Gl<br>carbonat<br>carbonat<br>*<br>al Seal)<br>Resistand<br>P54<br>HVE<br>400 \$<br>8 10 | X<br> <br> | X<br> <br> <br> <br> <br>S<br>W<br>Double<br>Single<br>th Scale<br>Scale<br>v Scale<br>v Scale<br>v Scale<br>v Scale<br>adj. Inde<br>dj. Inde<br>dj. Inde<br>dj. Inde<br>dj. Inde<br>Single | Black *<br>White<br>e Scale<br>Scale *<br>ex<br>ex<br>ex<br>Index<br>25 30 | 40 5                | 60 60                | 30°<br>60°<br>0° - Horiz<br>90° - Ver | tically * |  |
|  |   |               |      |   |                                 |              |  |  |  |   |   |  |                     |                      |                                       |           |  |

**lskra**®

Printed in Slovenia • Subject to change without notice • Version 2.00 / Jun-2016 • GB P 22.021.150



**Iskra, d.d.** Stegne 21 SI-1000 Ljubljana Slovenia Tel.: +386 1 51 31 000 Fax: +386 1 51 11 532 www.iskra.eu info@iskra.eu